


# Energy & Operational Savings

Wastewater Treatment

Annual Update to Operations Committee



2019-2027 Strategic Plan Priorities




# Sudbury Wastewater Treatment Plant

## Electricity Billing – Cost Avoidance

- Global adjustment (GA) is the portion of electricity costs that contribute to building infrastructure, maintaining resources and funding conservation programs.
  - The factor used to calculate GA can be reduced through participation in the Industrial Conservation Initiative (ICI)
- A mandatory ICI peak hiatus was introduced by the Ontario Government on June 26, 2020
  - Customers were allowed to use their data from 2019-2020 period for 2020-2021
  - Electricity use was curtailed for all 5 peaks in 2019
  - Reducing electrical costs allows for re-investment in facilities to complete necessary upgrade and repairs while also stabilizing rates.



# Sudbury Wastewater Treatment Plant Electricity Billing – Cost Avoidance

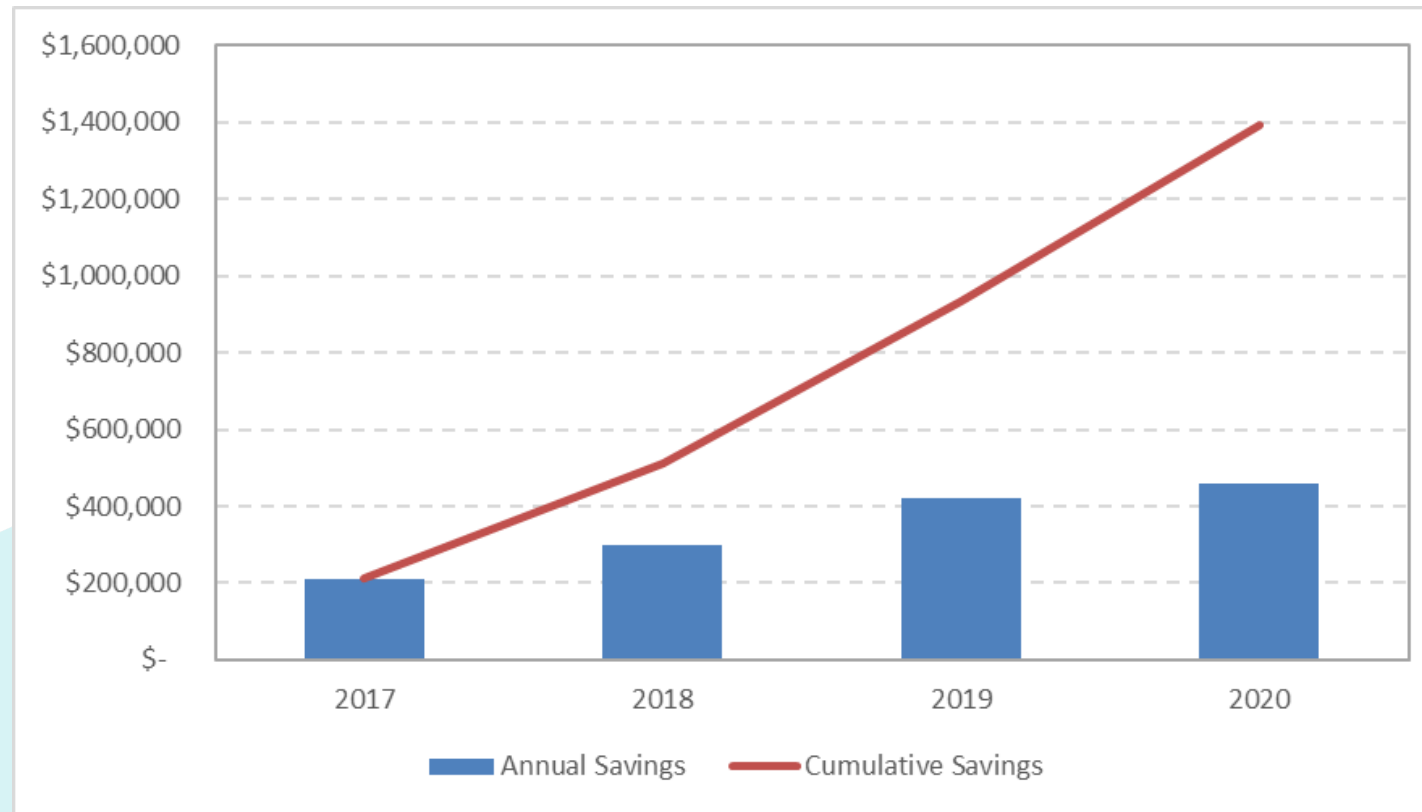

# Preventative Maintenance Tank Cleaning

- Aeration tanks cleaned as part of 3 year tender to address all critical process vessels in wastewater treatment plants (WWTP)
  - 2019: Sudbury and Walden WWTPs
  - 2020: Dowling, Levack & Coniston WWTPs
- Coniston WWTP presented a unique challenge as it uses an oxidation ditch instead of conventional aeration tanks



# Preventative Maintenance Tank Cleaning


- Contractor (Entec Waste Management) used small scale dredge to clean ditch with facility online
- Over 50 tonnes of compacted grit and debris removed from the facility





# Preventative Maintenance Tank Cleaning

- Removal of grit and debris improved retention time and dissolved oxygen levels
- Facility performance improved during shoulder season more consistent and higher average Total Suspended Solids (TSS) removal

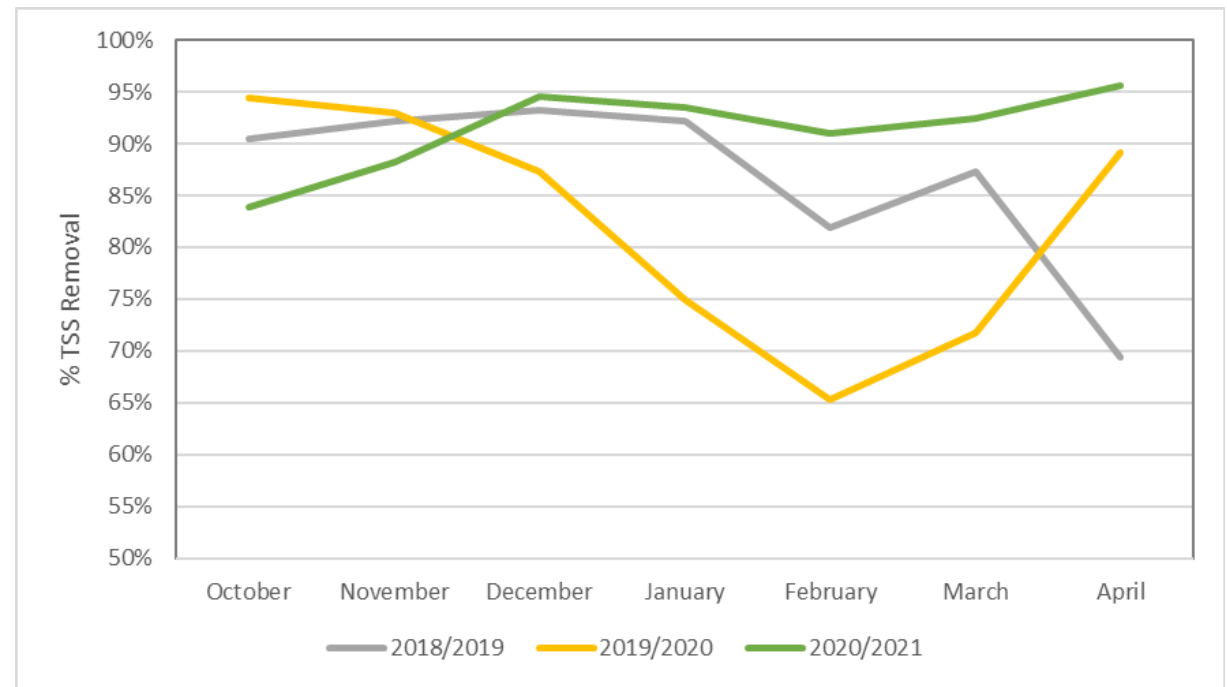

# Greater | Grand Sudbury™

[greater Sudbury.ca](http://greater Sudbury.ca)

